


POWER REQUIREMENTS:

1. Wiring and non-fusible safety switch(es) suitable for the line voltage to be provided by electrical contractor or others with branch circuit protection to each not exceeding 15 amps.
2. Branch circuit protection devices by others to be accessible when platforms are closed.
3. Verify electrical information:
Circuit 3 Phase, 208-230 Volts, 60 Hertz.
Each 1/2 Horse Power Motor Draws 2.0-2.2 amps. Full Load.
Motors run simultaneously.
4. Junction box(es) by electrical contractor to be mounted at locations TBD, 5' AFF. Typical location shall be at section joints.

Bank 1 - 80'-0" Friction Power
Building Code: IBC 2006
82'-8" Clear Dimension
12 Row - 24" Span - 10.25" Rise
523 seats (SM10)

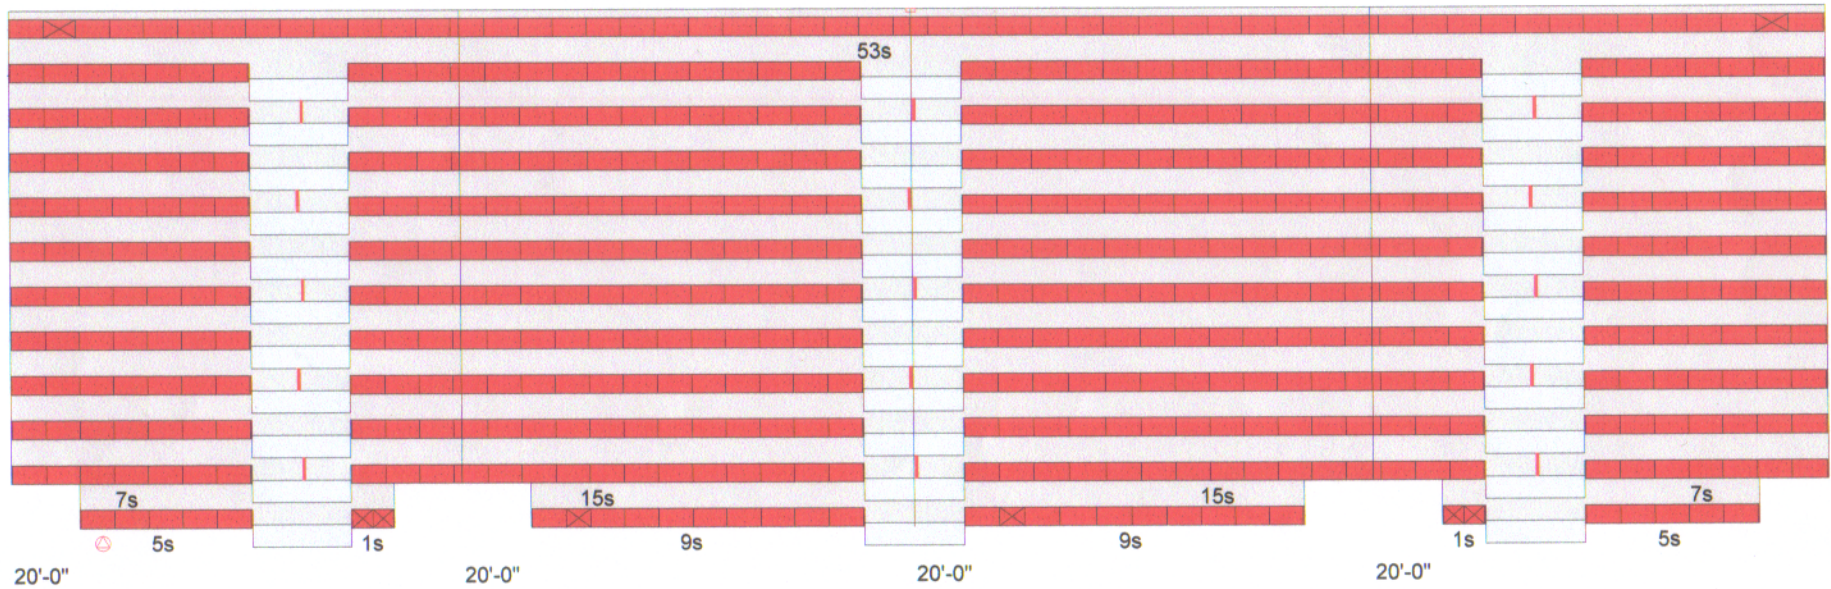

5981 East Cork Street, PO Box 2107, Kalamazoo, MI 49003-2107
telephone (269) 349-1521 fax (269) 349-6530

Drawings produced by this program are only as good as the information provided. These drawings are PRELIMINARY only.
All drawings created are subject to Interkal approval for design and construction capability.
Printed: January 18, 2011 v1.17.1